MARIPOSA PUBLIC UTILITY DISTRICT

REVISION:	DATE:
	8/15/14

STANDARD TITLE:

SERVICE INSTALLATION DETAIL - 1" & 2" DIA.

DWG No: 10

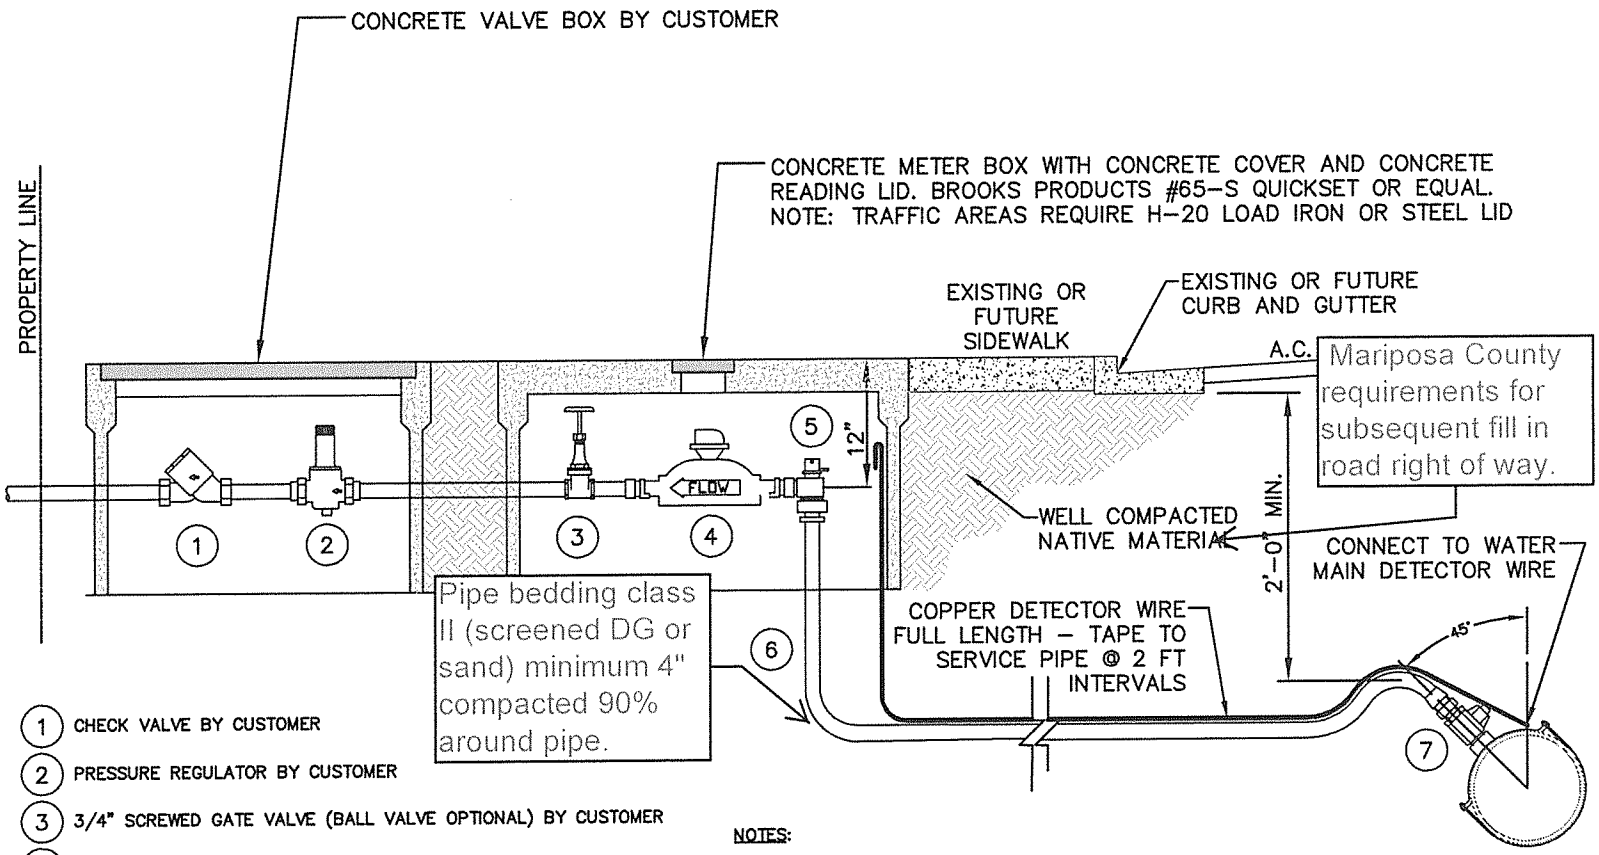

1. CHECK VALVE BY CUSTOMER
2. PRESSURE REGULATOR BY CUSTOMER
3. 3/4" SCREWED GATE VALVE (BALL VALVE OPTIONAL) BY CUSTOMER
4. BADGER METER OR EQUAL SUPPLIED BY THE DISTRICT
5. 1" x 3/4" ANGLE METER STOP
6. 1" POLYETHYLENE PE3408, PRESSURE CLASS 200 PSI TO ASTM D3350
7. 1" SERVICE CONNECTION AND CORP. STOP

NOTES:

IF METER BOX IS LOCATED OUTSIDE OF TRAVELLED WAY, IT MAY BE A FIBERGLASS CONSTRUCTED BOX. SUBMITTAL TO MPUD IS REQUIRED.

FOR 2" SERVICE, ALL CONNECTIONS TO POLYETHYLENE LINE SHALL BE "PACK JOINT" WITH STAINLESS STEEL INSERTS.